


INSTALLATION INSTRUCTIONS

1. Place the accessory on the ceiling and pinpoint the position of the holes. Drill two holes with a diameter of 5 mm and insert the supplied plugs.
2. Anchor the accessory on the ceiling using the supplied cross-head screws (PZ2). Minimize the excess of cable inside the accessory to make the device installation easier.
3. Remove the retaining springs from the EyeZen device by pressing its endings and pulling and then fix it inside the accessory. Verify that the device remains completely inserted.


Optional. In case of electrical installation in conduit, precut circles on both sides of the accessory make it easier to perforate the hole for cabling. However, the hole could be made in any place of the accessory depending on the installation needs.

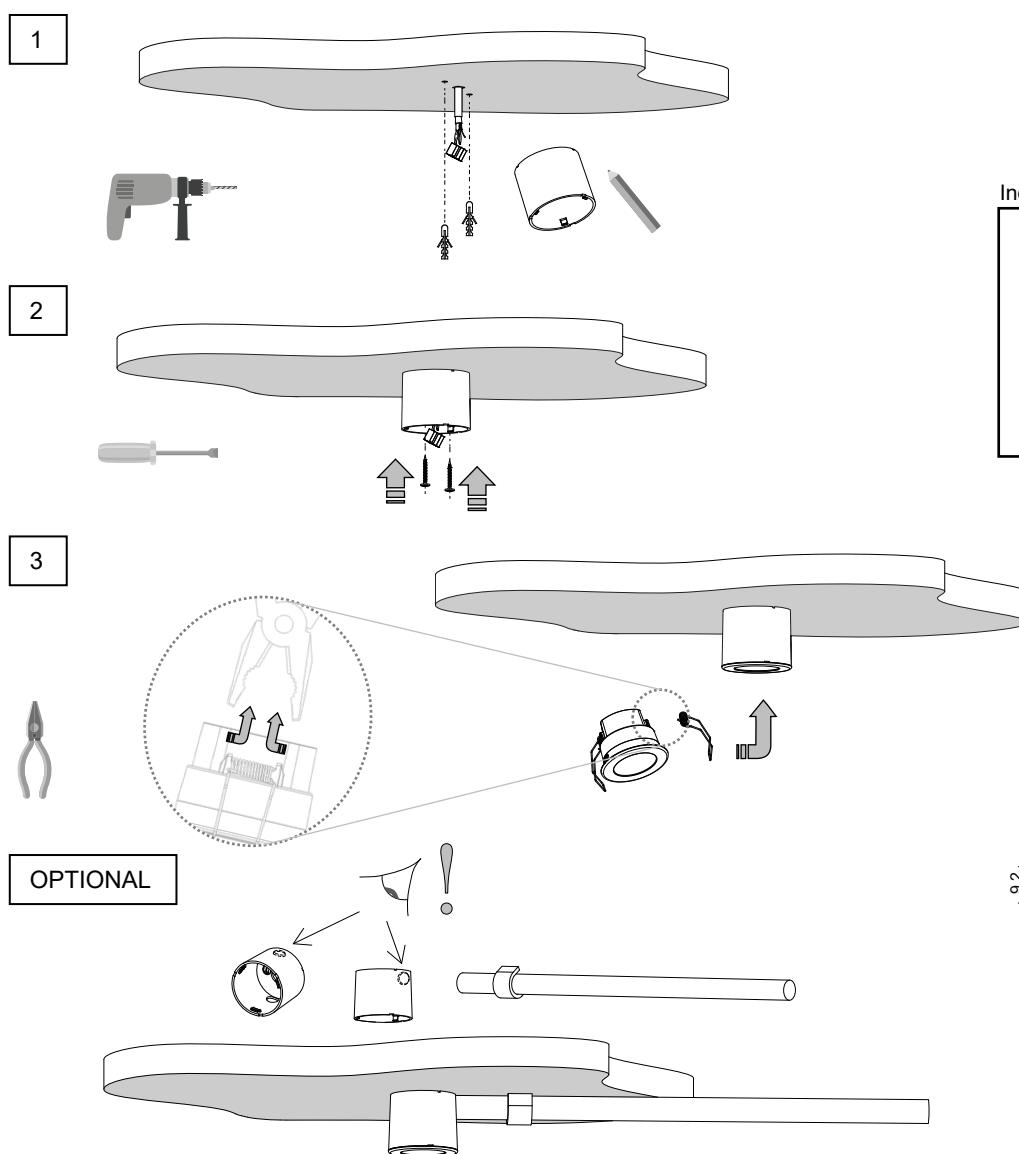


Compatible devices:

EyeZen IN family
EyeZen TP family
EyeZen RF family

Included elements

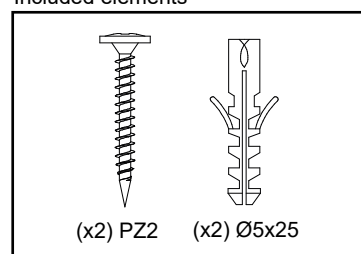

DIMENSIONS (MM)

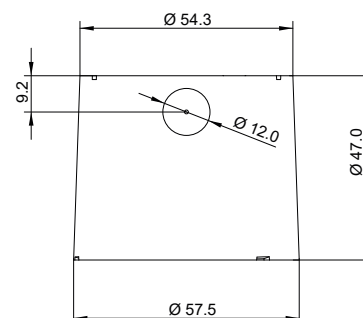

SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point different to a Zennio input; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the input.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.